


REMARKS:

1. Pipe network is being led in the suspended ceiling of the groundfloor, and the connections on heating appliances are done from the floor
2. The slope of pipe network is towards main vertical drain
3. Exhaust for the air is done via automatic vent faucets on heating appliances
4. Every heating appliance consists faucet with presetting, valve and automatic vent faucet
5. Heating appliances are not to be colored, they are delivered in the tone by the investor's wish
6. All heating appliances are connected with wall consoles designed for this type of heating appliances

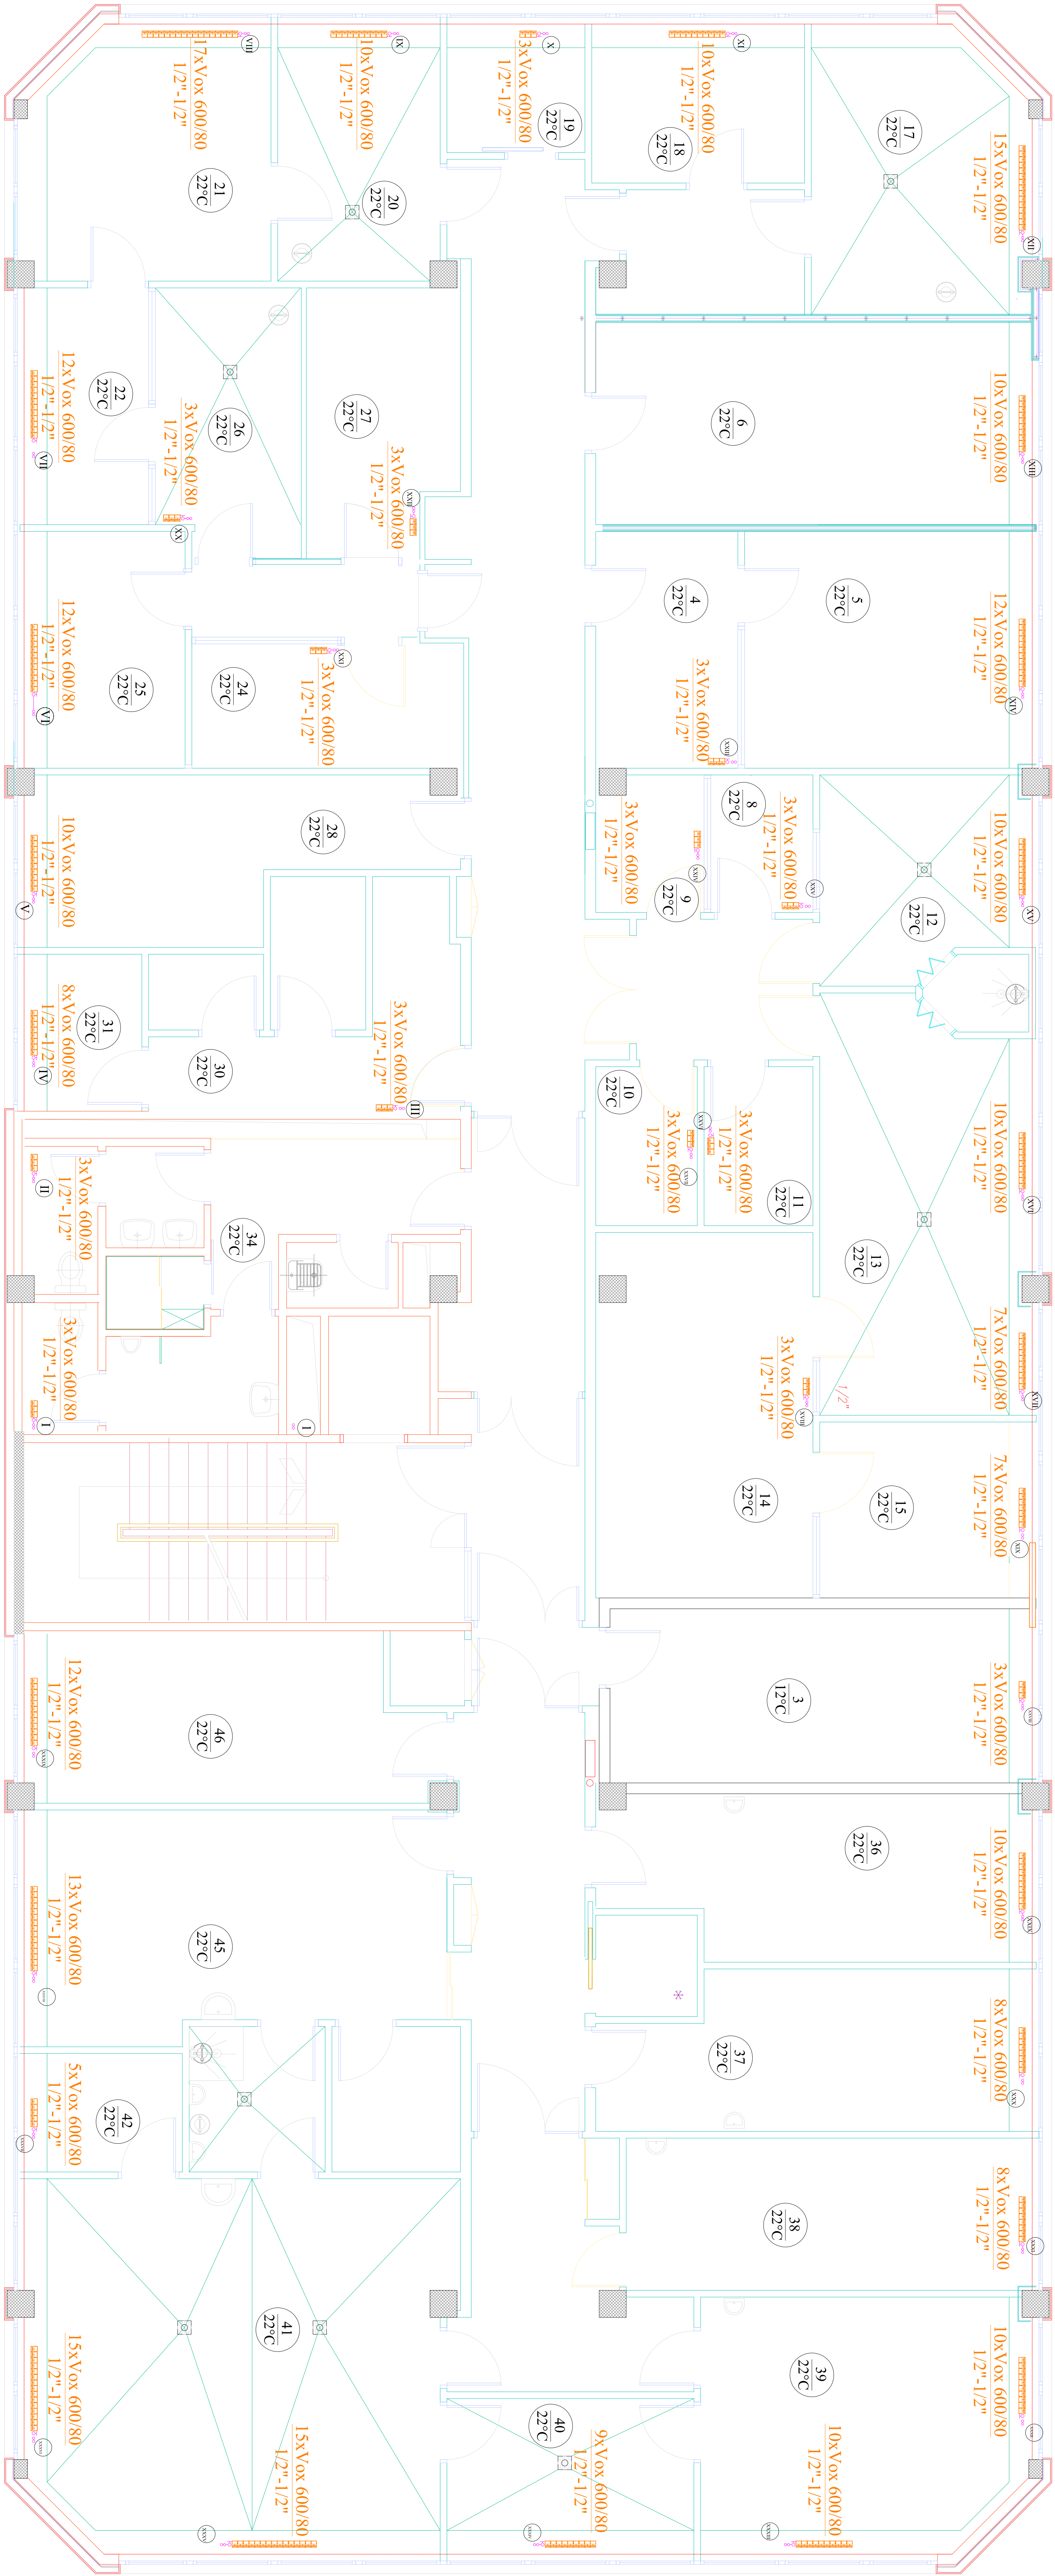

INVESTOR:	Ministry of Justice, Republic of Serbia		
OBJECT:	LKP SANIC laboratoris , BELGRADE		
phase of the project:	RECONSTRUCTION AND MODERNIZATION OF THE EXISTING FACILITY AND NEW CONSTRUCTION PROJECT		
responsible architect:	INSITUATION PROJECT		
date:	March, 2013		
scale:	drawing no. G-1		